


TOP VIEW

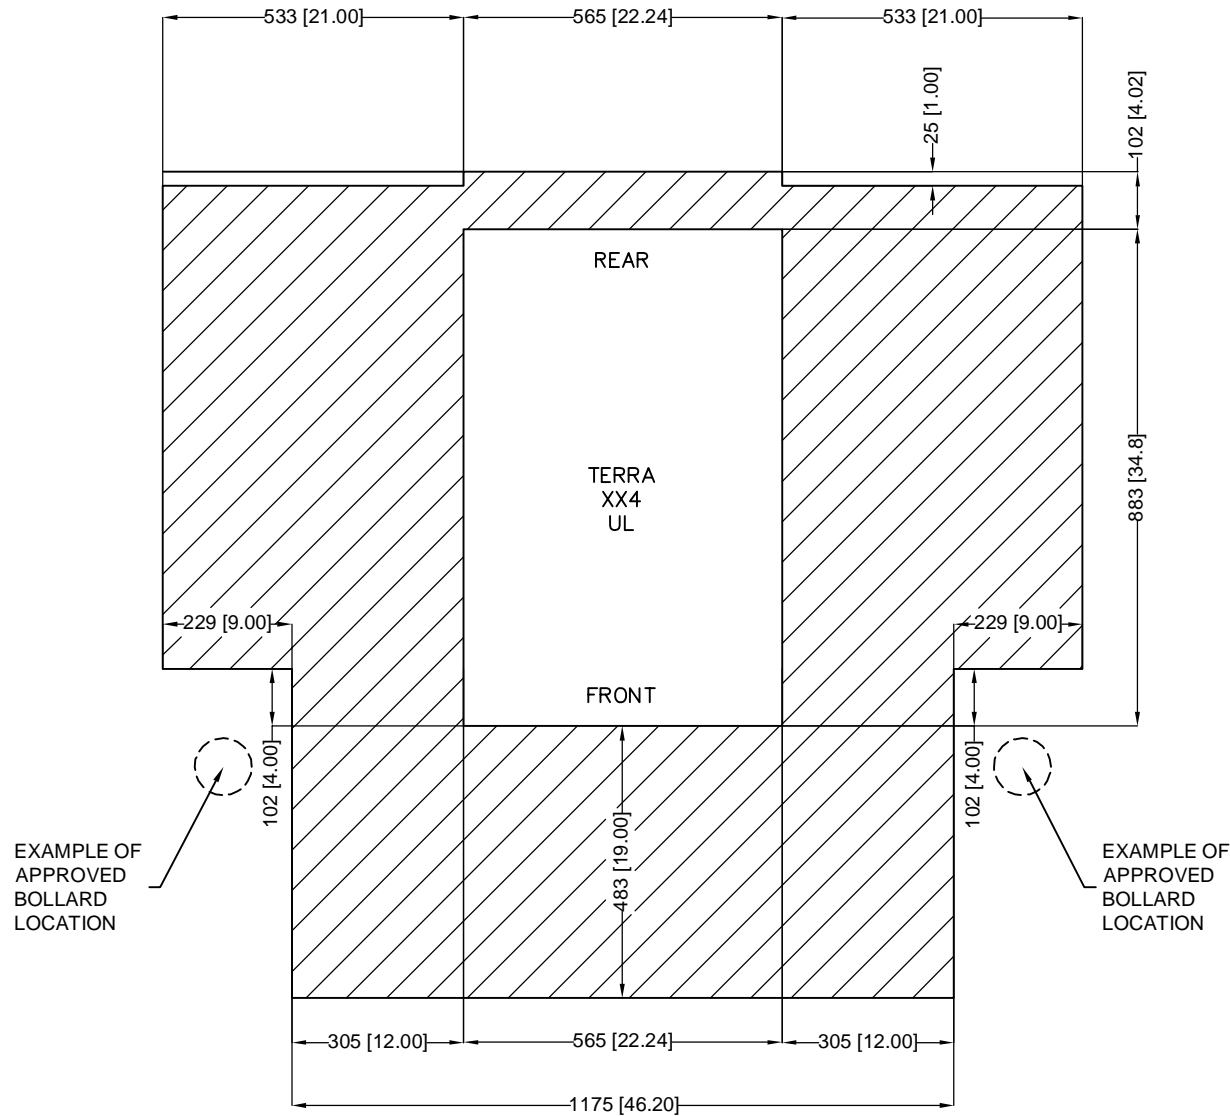

NOTES:

1. ABB IS NOT RESPONSIBLE FOR DAMAGE TO THE EV CHARGER BASED ON BOLLARD PLACEMENT.
2. INSTALLATION OF EV CHARGER AND BOLLARDS MUST COMPLY WITH NEC WORKING SPACE CLEARANCES.
3. THE EVSE REQUIRES SERVICE ACCESS TO FRONT DOOR AND BOTH SIDE DOORS. REQUIREMENTS OF LOCAL CODES (i.e. NEC MIGHT REQUIRE 42 INCHES IN FRONT OF EACH OF THE DOORS) PREVAIL.
4. CABLE RETRACTION NOT SHOWN ATTACHED TO THE UNIT.

TERRA TXX4 (T94, T124, T184) UL
 NO BOLLARD ZONE

DIMENSIONS: mm [in]